




*MCS Total  
Solutions for all your  
Control Needs*

# *Water Cooled Chiller Upgrade Package(s)*

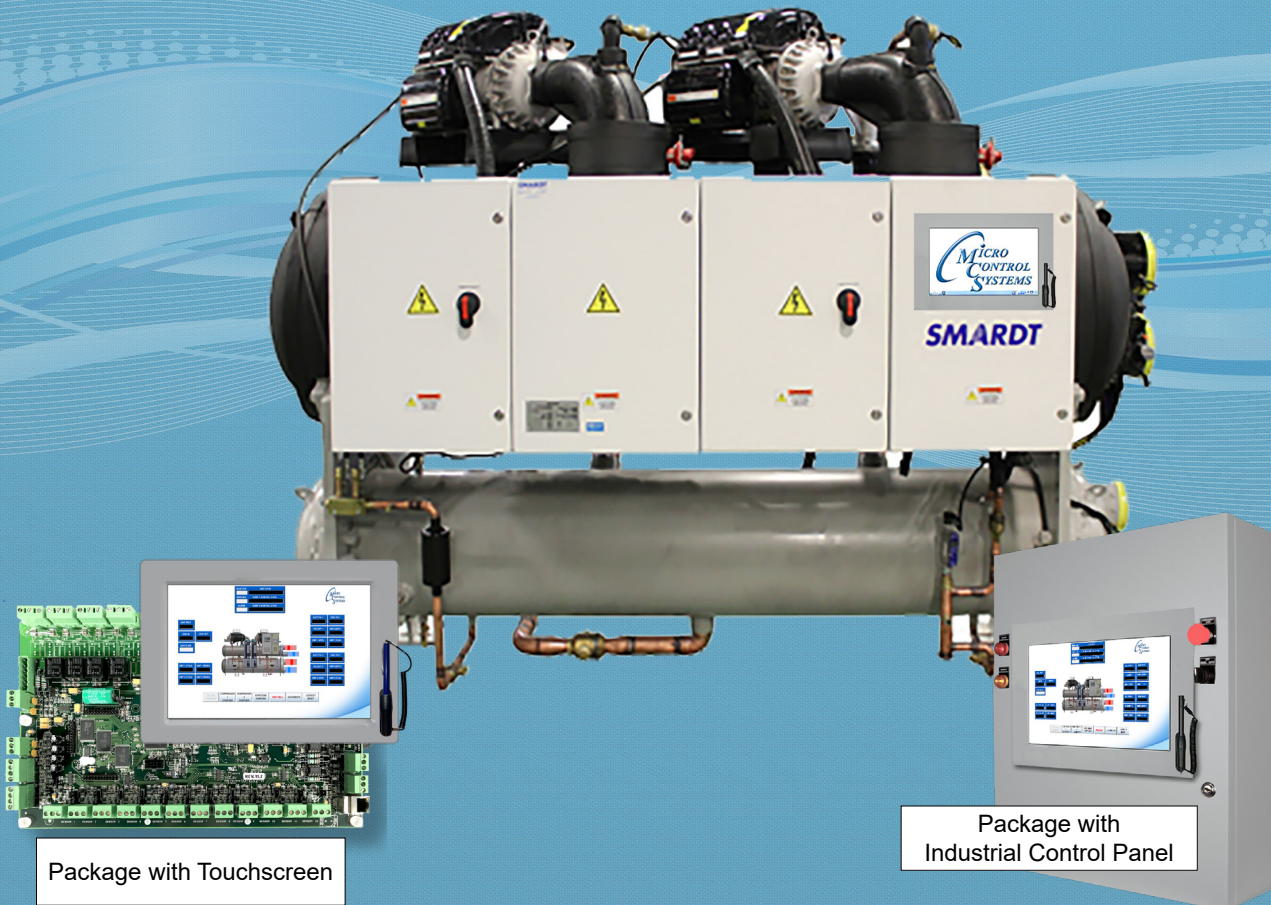

This brochure describes a standard upgrade package for the Turbocor series chillers. Each control upgrade installation is unique. It may be necessary to add additional options to the standard upgrade as described in this brochure.

Fill out the brief questionnaire in the back of this brochure and forward to your sales representative for an estimate.



# Typical Upgrade

## Package with Industrial Control Panel

### Concerns:

- Old controls failed
- Wanted controls that were easier to understand and greater reliability, plus better and clear information

### Equipment:

- Smardt and other brands Water Cooled Chillers
- One to Four Turbocor Compressors
- One to Four Staging Valves
- Load balancing EXV control
- Modulating condenser water valve

### Steps Taken:


- Remove existing controls
- Install MCS controls
- Reprogram boards for communication
- Provide on-site training and support for contractor to better understand MCS controls.

### Results:


One Smardt Chiller upgraded with MCS controls and one satisfied customer who is very happy with all the information and data available compared to the competitor's controls.




Old Controls

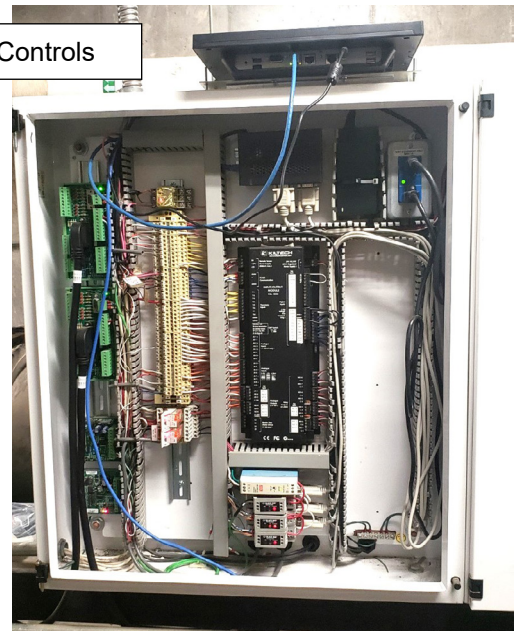

New MCS Touchscreen

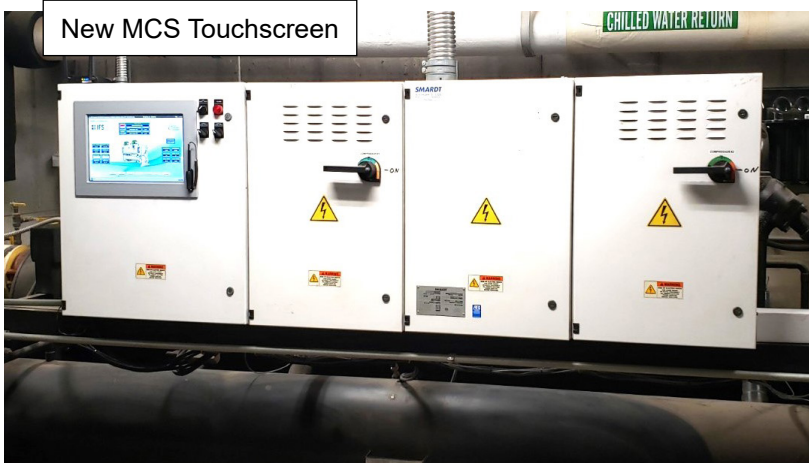

New Controls

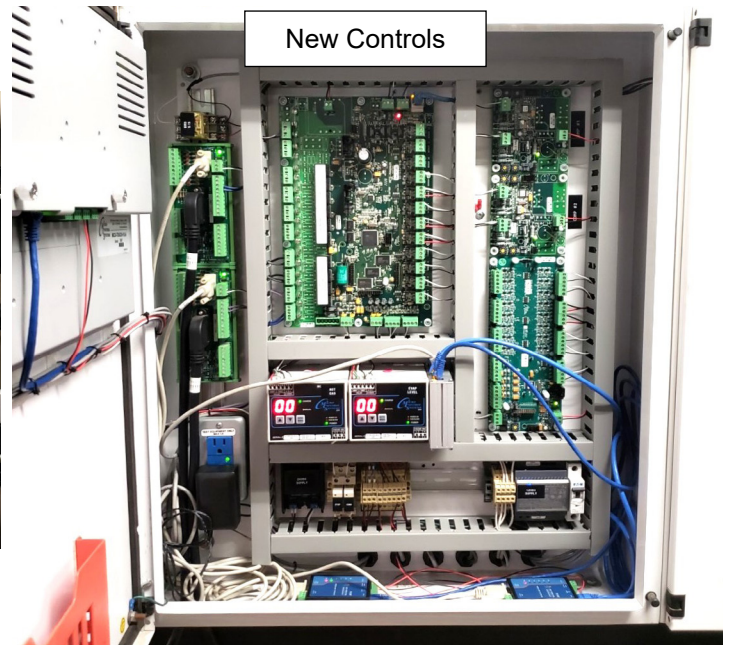

# MCS-MAGNUM--15.4-12



Part # MCS-MAGNUM-15.4-12

## Description

The MCS-MAGNUM-15.4-12 consists of a MCS-MAGNUM controller along with a Touchscreen 15.4 in display.

The MCS-TOUCH-15.4 capacitive touchscreen interface designed to simplify user access with the MCS-Magnum and MicroMag utilizing MCS-Connect to provide both graphics and service mode access to technicians. Input method: Finger, Stylus or \*Glove.

Highly accurate and does not require calibration - easy to clean glass surface. Works outdoors, bright screen, water resistant, Exceptional Optics - 1280x800 resolution, sharp and vibrant images.

MCS-TOUCH-15.4 comes preloaded with the MCS-CONNECT program that allows you to view the 'unit's status', 'extended history', 'alerts', 'alarms', setpoints, and more, all in a user-friendly graphic format. The MCS-TOUCH-15.4-12 can connect up to 60 MCS controllers and supports RS485 or Ethernet networking.

The MCS-MAGNUM-N is a durable microprocessor based controller designed for the hostile environments in the HVAC/R industry. It is designed to be the primary manager of the package it is controlling. The Magnum provides flexibility with setpoints and control options that can be selected prior to commissioning a system or when the unit is live and functioning. Displays, alarms and other interfaces are accomplished in a clear and simple language that informs the user as to the status of the controller.

The MCS-MAGNUM-N is a UL Recognized Component under UL File #168780 and also ROHS compliant.

Complementing the Magnum micro controller are a variety of MCS expansion boards.

## Packaging

MCS-SHIELDWIRE-GROUNDING multi-terminal splicing connector with 9- 18 awg wire with ring terminal (package of 2).



Ship Weight ..... 8.73 lb (approx)  
Box Dimensions ..... 16" x 12.5" x 8" (approx)

## Specifications

### MCS-Magnum Controller

Dimensions .....	12.0"W, 8.0"H, 2.0"D
Mounting Holes .....	Mounts on a backplane utilizing 8 through-hole studs
Operating Temperature .....	-40°F to +158°F (-40°C to +70°C)
Operating Humidity .....	0-85% Non-Condensing
Storage Temperature .....	-40°F to +158°F (-40°C to +70°C)
Microprocessor .....	Zilog eZ80 Acclaim! @ 50mhz
Sensor Inputs (SI) .....	12 inputs 0-5vdc (10-bit A/D)
Digital Inputs .....	4 inputs 0 or 5vdc only
Relay Outputs (RO) .....	10 outputs 6.3amps @ 230vac
Analog Outputs (AO) .....	4 outputs 0-10vdc
Printed Circuit Board .....	Six layer with separate power and ground planes
Input Power (Standard) .....	+12vdc power in board from 95-265vac switching power supply
	77°F (25°C) ambient, 20mA max
MCS-I/O Comm Port .....	1 @ 38,400 baud
RS-485 Comm Port .....	1 @ 18,200 baud
Ethernet .....	10/100 Mbps Ethernet
Real Time Clock .....	Battery backup
Power Detection .....	Automatic power fail reset

### MCS-TOUCH-15.4 - Capacitive Touchscreen

Dimensions .....	17"L x 12.1"W x 2"H
LCD Screen .....	15.4" (16:10 Diagonal) 1280 x 800 Resolution Soft Touch Capacitive Stylus pen
Gasket .....	BESCO HT-820-Firm Cellular Silicone
Operating Temperature .....	-22°F to 176°F (-30°C to +80°C)
Operating Humidity .....	80 %RH (Non Condensing)
Storage Temperature .....	-22°F to 176°F (-30°C to +80°C)
Motherboard-Rev 4.0 .....	Freescale iMX8 Dual Core 800mhz 2Gb of 512mhz DDR3 RAM memory 16Gb of eMMC Flash memory 10m/100m/1G Ethernet 1 Micro-SD Slots 2 USB Host 2.0 Real Time Clock (RTC) w/ Battery 3 RS485 communication ports
Touchscreen Surface .....	UV Degradation Protection

### Parts Included

- 50W 12VDC Power Supply  
Input Voltage: 88VAC to 264 VAC  
Output Voltage: 12VDC @ 7.5Amps  
Input Current: 3A / 115 AC - 1.8A / 230AC  
Output Rated Current: 7.5A  
Size: 2.76" x 3.54" x 2.14" (WPHD) (70\*90\*54.5mm)
- 7ft CAT 5e Crossover Patch Cord, Orange
- Kit of (8) #6 x 1" Phillips Pan head Zinc Plated Steel Screws




5580 Enterprise Pkwy., Fort Myers, FL 33905  
Office: 239-694-0089 • Fax: 239-694-0031 [www.mcscontrols.com](http://www.mcscontrols.com)

\* The glove needs to have a conductive fabric or material to work with cap touchscreens.



# MCS Industrial Control Panel

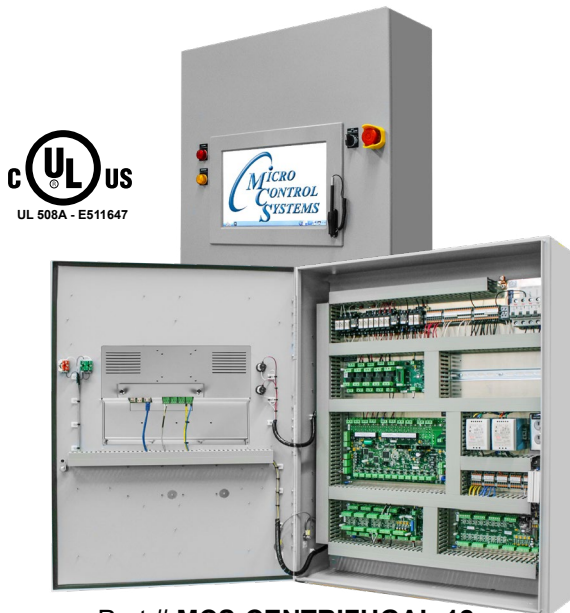

Part # MCS-CENTRIFUGAL-12

## Description

The MCS-CENTRIFUGAL-12 Industrial Control Panel is made of powder coated aluminum for durability and longevity. A left hand swing door is mounted with three eight-inch hinges for strength. A key lock is provided for security on the door while still giving easy access of the display. This panel is intended for use in an environment protected from the weather.

The control panel consists of a MCS-MAGNUM-N-12, MCS-TOUCH 15.4" touchscreen, MCS-SI-BASE(2) with MCS-SI-EXT(1), MCS-RO-BASE(1) with MCS-RO-EXT(1) expansion boards.

12VDC and 24VDC power supplies included.

The MCS-TOUCH-15.4 capacitive touchscreen interface designed to simplify user access with the MCS-Magnum and MicroMag utilizing MCS-Connect to provide both graphics and service mode access to technicians. Input method: Finger, Stylus or \*Glove.

Highly accurate and does not require calibration - easy to clean glass surface. Works outdoors, bright screen, water resistant, exceptional Optics - 1280x800 resolution, sharp and vibrant images.

The MCS-TOUCH-15.4-12 can connect up to 60 MCS controllers and supports RS485 or Ethernet networking.

Control panel includes the following; 20A, 16A and a 5A Single-Pole Circuit Breaker. A 5-port 10/100/1000 Mbps Ethernet Workgroup Switch Industrial rated, Red Alarm Indicator, Yellow Warning Indicator, Emergency Stop Switch with guard and 3 Position Run/Stop Selector Switch.

SHIELDWIRE-GROUNDING multi-terminal connectors are included to eliminate stray electrical current, thereby helping to reduce line noise from the sensors to the controller.

## Packaging

Weight ..... 90 lbs(approx)  
Box ..... 29" x 10" x 37"

## Specifications

**Certification**..... UL508A - E511647

### **NEMA Rating – Type 1 Control Panel**

Enclosure is intended for indoor use primarily to provide a degree of protection against contact with the enclosed equipment and is not protected from liquids.

### **Industrial Control Panel**

Dimensions of control panel .. 27"w x 39.75"h x 8.0"d

Mounting Holes..... Mounts with four pre-drilled  
15/32" holes

Rated Voltage (Standard)..... 120VAC or 230VAC

Phase / Frequency ..... 1 Phase / 60Hz

Full Load Current(approx) ... 40A at 120VAC or 20A at 240VAC

Short Circuit Current Rating . 10kA

### **Temp. Range for Control Panel & Touch Screen**

Operating Temperature..... -4°F to 158°F (-20°C to 70°C)

Operating Humidity..... 0-95% Non-Condensing

Storage Temperature..... -4°F to 158°F (-20°C to 70°C)

### **MCS-MAGNUM Specification**

Microprocessor ..... Zilog eZ80 Acclaim! @ 50mhz

Sensor Inputs (SI)..... 12 inputs 0-5vdc (10-bit A/D)

Digital Inputs..... 4 inputs 0 or 5vdc only

Relay Outputs (RO) ..... 10 outputs 6.3amps @ 230vac

Analog Outputs (AO)..... 4 outputs 0-10vdc

Printed Circuit Board ..... Six layer with separate power  
and ground planes

Input Power (Standard) ..... 12 vdc Regulated Power Supply

Minimum (Brown in) ..... 9.44 vdc

Amp Draw (Loaded) ..... 857.0 mA

RS-485 Comm Port ..... 1 @ 19,200 baud

Ethernet ..... 10/100 Mbps Ethernet

Real Time Clock ..... Battery backup

Power Detection ..... Automatic power fail reset

### **MCS-SI-BASE/EXT Expansion Boards**

Sensor Inputs (SI)..... 48 inputs 0-5vdc (2 Base/1Ext)

Analog Outputs (AO)..... 12 outputs 0-10vdc

MCS-I/O Comm Port ..... 1 @ 38,400 baud

### **MCS-RO-BASE/EXT Expansion Boards**

Relay Outputs (RO)..... 20 outputs 6.3amps @ 230vac

MCS-I/O Comm Port ..... 1 @ 38,400 baud

### **MCS-Touch-15.4 - Capacitive Touchscreen**

Dimensions..... 17"L x 12.11"W x 3.228"H

LCD Screen..... 15.4" (16:10 Diagonal)

16.2 Million Colors

1280x800 Resolution Touchscreen

Soft Touch Capacitive Stylus pen

Gasket..... BISCO HT-820-Firm Cellular Silicone

Touchscreen Surface..... UV Degradation Protection

### **Power Supply - Specification**

**12vdc power supply**..... 85vac ~ 264vac

AC frequency range..... 47 ~ 63Hz

Output rated current..... 7.5A

Output rated power..... 90W

**24vdc power supply**..... 85vac ~ 264vac

AC frequency range..... 47 ~ 63Hz

Output rated current..... 4A

Output rated power..... 96W

Crossover Cable (orange) ..... can be used for connecting  
MCS Touchscreen direct to MCS-MAGNUM or to a Laptop


5580 Enterprise Pkwy., Fort Myers, FL 33905

Office: 239-694-0089 • Fax: 239-694-0031 [www.mcscontrols.com](http://www.mcscontrols.com)



# MCS-MAGNUM/Touchscreen Graphics

## MCS-MAGNUM-N-12

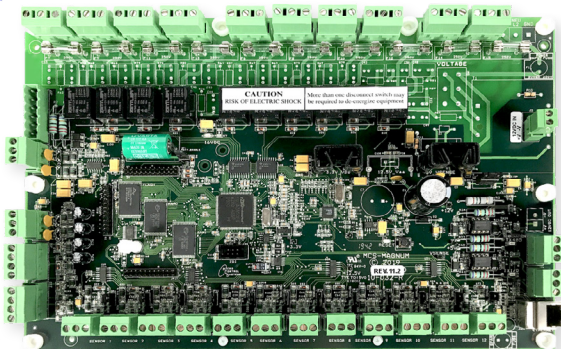

The **MCS-MAGNUM-N-12** is a durable microprocessor based controller designed for the hostile environments in the HVAC/R industry. It is designed to be the primary manager of the package it is controlling.

The Magnum provides flexibility with set points and control options that can be selected prior to commissioning a system or when the unit is live and functioning. The TouchScreen and MCS-CONNECT provide a clear and simple language that informs the user as to the status of the controller.

## Touchscreen


The **MCS-TOUCH-15.4** capacitive touchscreen interface designed to simplify user access with the MCS-Magnum and MicroMag utilizing MCS-Connect to provide both graphics and service mode access to technicians. Input method: Finger, Stylus or \*Glove.

Highly accurate and does not require calibration - easy to clean glass surface. Works outdoors, bright screen, water resistant, exceptional Optics - 1280x800 resolution, sharp and vibrant images.

MCS-TOUCH-15.4 comes preloaded with the MCS-CONNECT program that allows you to view the 'unit's status', 'extended history', 'alerts', 'alarms', setpoints, and more, all in a user-friendly graphic format. The **MCS-TOUCH-15.4-12** can connect up to 60 MCS controllers and supports RS485 or Ethernet networking.

### Standard screens include:

- System Overview Screen
- Compressor Overview Screen
- Evaporator/Condenser Overview Screen
- Documents

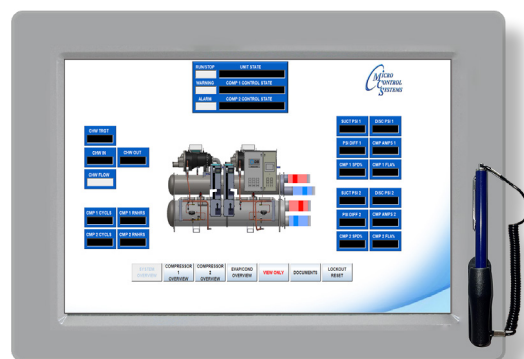


SYSTEM OVERVIEW



COMPRESSOR OVERVIEW



EVAPORATOR CONDENSER  
OVERVIEW SCREEN

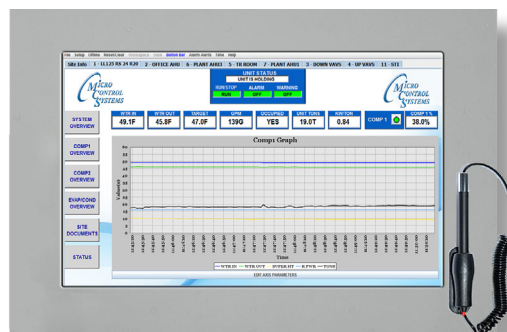

OPTIONAL  
'GRAPHS OVERVIEW SCREEN IN  
REAL TIME'



\* The glove needs to have a conductive fabric or material to work with cap touchscreens.



# Typical Upgrade

## MCS-SI-BASE

The **MCS-SI-BASE** provides a flexible and cost effective way to allow sensor input and analog output expansion for the **MCS MAGNUM**. Each MCS-SI-BASE has a stand-alone microprocessor which communicates with the MCS MAGNUM over the MCS-I/O port at 38,400 baud. All data is check summed with auto error correction. Because communication is over a RS-485 long distance two-wire differential network transmission system, the MCS-SI-BASE may be located up to 5,000 feet away. MCS-SI-BASE board can be powered by a 12VDC regulated power supply and has a automatic power fail reset system.

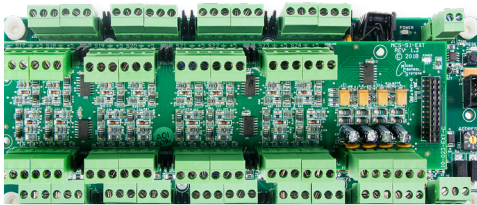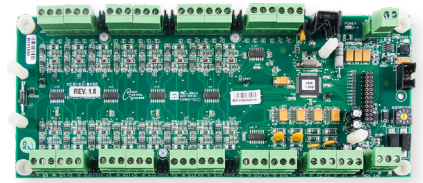



MCS-SI-EXT mounted to  
MCS-SI-BASE

## MCS-SI-EXT

The **MCS-SI-EXT** provides a flexible and cost effective way to allow sensor input and analog output expansion for the **MCS MAGNUM**. Each MCS-SI-EXT can be paired with a MCS-SI-BASE to double the number of inputs and outputs. Each MCS-SI-EXT board is powered by the MCS-SI-BASE board once it is stacked on top.

## MCS-RO-BASE

The **MCS-RO-BASE** provides a flexible and cost effective way to allow relay output expansion for the **MCS-MAGNUM**. Each MCS-RO-BASE has a stand-alone microprocessor which communicates with a Magnum/Micromag over the MCS-I/O port at 38,400 baud. All data is check summed with auto error correction. Because the communication is over a RS-485 long distance two-wire differential network transmission system, the MCS-RO-BASE may be located up to 5,000 feet away. The MCS-RO-BASE board is powered by a 12VDC regulated power supply.

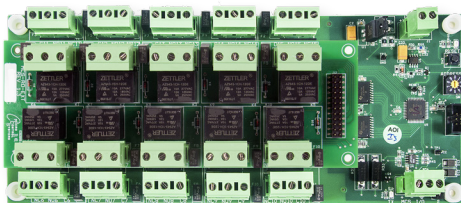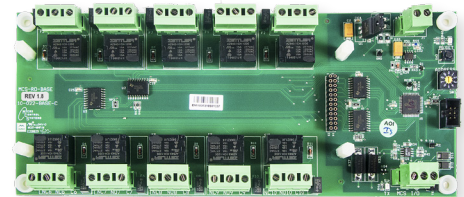

MCS-RO-EXT mounted to  
MCS-RO-BASE

## MCS-RO-EXT

The **MCS-RO-EXT** provides a flexible and cost effective way to allow relay output expansion for the **MCS MAGNUM**. Each MCS-RO-EXT can be paired with a MCS-RO-BASE to double the number of outputs. MCS-RO-EXT board is powered by the MCS-RO-BASE board once it is stacked on top.

## MCS-PRESSURE TRANSDUCERS

The **MCS Pressure Transducers** are one of the most economical and durable options on the market for dealing with high-pressure industrial applications.

In addition to being CE and UL approved, MCS transducers are capable of surviving high vibration. They include a cavity built out of solid 17-4 PH stainless steel 1/4" SAE Female Flare fitting & Schrader valve; 7/16-20 UNF pipe thread which creates a leak-proof, all metal sealed system that makes the transducers ideal for use with rugged HVAC environments.





# Typical Upgrade

## MCS-T-100 Temp Sensor



An extremely fast acting temperature sensor built for demanding environments. It is ideal for high moisture locations with continuous freeze and thaw cycles. The sensor is potted with a thermally conductive RTV Cure Silicon Adhesive to guarantee durability and response. Its high accuracy allows for interchangeability in the field. The large resistance range allows the use of over 1000' of cable with no noticeable effect. The MCS-T100 sensor has the ability to move from 32°F to 212°F in approximately 10 to 15 seconds.

## MCS-Wells/Tubes

The MCS-WELL was designed to be used with the MCS-T100 temperature sensor, although it has other applications. It is used in the 30HXC series chillers in the chilled water and condenser water lines. It comes pre-filled with heat conductive compound to aid in temperature to the sensor.



1/4- 2.5"



The **MCS-TUBE** can be epoxied to a discharge or suction line on the 30HXC series chillers in order to obtain temperature readings without the use of a well. It was designed to be used with the MCS-T100 temperature sensor and comes pre-filled with heat conductive compound to aid in transferring temperature to the sensor.

## MCS-EPOXY

- Pre measured resins and hardeners in one tube
- Easy to use - bonds, seals, plugs, molds and rebuilds
- No special tools needed
- Can even harden under water




- Pressure tested to ..... 1300 psi
- Temperatures up to ..... 500 degree F
- Color ..... Gray
- Density ..... 15.9 lb/gal (1.9 g/cc)
- Hardness (Shore D) ..... 85
- Tensile Strength ..... 6000 psi
- Compressive Strength .... 18.000 psi
- Modulus of Elasticity ..... 6 x 10<sup>5</sup> psi
- Shear Strength ..... 700 psi



# Typical Upgrade

## MCS-VOLTAGE-3PH

The **MCS-VOLTAGE-3PH** measures AC voltage between 200-600 AC. It is designed to monitor the voltage of each phase of the main input power to the unit. The MCS-VOLTAGE-3PH sensor provides three separate DC voltage outputs that correspond to the AC voltage it is measuring.

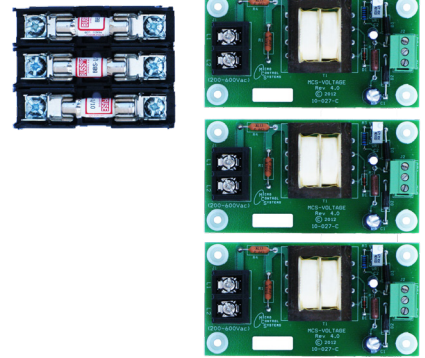

## MCS-PHASE

The **MCS-PHASE** is a programmable 3-phase line voltage monitor with 25-fault memory, high temperature LCD display, easy setup and clear diagnostic readout of system faults. The MCS-PHASE was specifically designed to protect motors and other 3-phase loads from premature failure and damage due to common voltage faults such as unbalance, over/under voltage, phase loss, reversal, incorrect sequencing and rapid short cycling.

## MCS-USB-RS485

The **MCS-USB-RS485** is a USB to RS485 cable that provides a fast simple way to connect a **MCS-MAGNUM** to a Laptop or PC.

The MCS-USB-RS485 cable contains a small internal electronic circuit board, which converts USB to RS485 with LED indicators for transmit (TX=Red) and receive (RX=Green).



## MCS-EXV-DRIVER

The **MCS-EXV-DRIVER** is used for the positioning and control of Sporlan, Alco, Carel, and Danfoss bipolar expansion valves using an analog input of 0-10 VDC (0 VDC = 0% valve opening, 10 VDC = 100% valve opening). The MCS-EXV-DRIVER also supports overdriving on full opened and full closed voltage signals. The display decimal notifies when overdriving by blinking.




# Typical Upgrade

## MCS-RS-485 EXTENDER

For those installations requiring an RS-485 port to be accessible without the necessity of opening the Control Cabinet door, MCS offers the part shown above.

The MCS-RS-485-EXTENDER mounting plate can mount on the outside of your enclosure and plugs into the RS-485 port on the back of the keypad.

A removable three-position terminal block is provided for easy wiring. to the keypad.

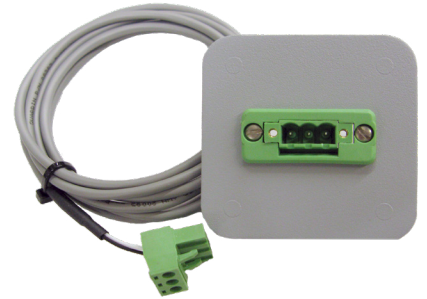

## MCS-SEHI/SERI


The **MCS-SEHI/SERI** are Electronically Operated Step motor flow control valves, intended for the precise control of liquid refrigerant flow. Synchronized signals to the motor provide discrete angular movement, which translates into precise linear positioning of the valve piston. Valve pistons and ports are uniquely characterized, providing improved flow resolution and performance. The MCS-SEHI/SERI valves are easily interfaced with MCS microprocessor based controllers.



## BMS GATEWAY

The **MCS-BMS-GATEWAY** is a microprocessor based communication device that provides translation from Bacnet IP, Bacnet MSTP, Modbus IP, Lontalk, or Johnson N2 communication interface. Information that can be transmitted includes the status of control points, alarm information, digital inputs, analog inputs or setpoints.

The MCS-BMS-GATEWAY protocol is field selectable by setting jumper on the device. Using **MCS-CONFIG** and the CONFIG files for the MCS-MAGNUM, you can automatically create the CSV files that is required by the MCS-BMS-GATEWAY.

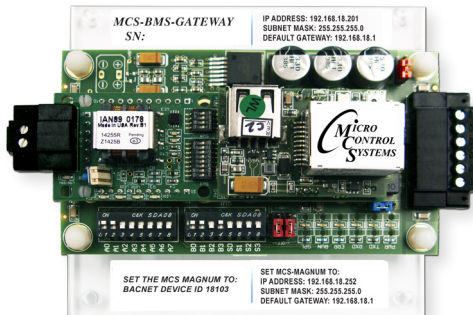



# Typical Points List

## Relay Outputs

#	Output Name	Type	Description
M-1	SPAREM-1	Standard	Relay output not used
M-2	SPAREM-2	Standard	Relay output not used
M-3	SPAREM-3	Standard	Relay output not used
M-4	SPAREM-4	Standard	Relay output not used
M-5	SPAREM-5	Standard	Relay output not used
M-6	Cmp1I-Lock	Standard	Comp 1 J2 TurboCor Interlock
M-7	Cmp2I-Lock	User Logic	Comp 2 J2 TurboCor Interlock
M-8	Cmp3I-Lock	User Logic	Comp 3 J2 TurboCor Interlock
M-9	Warning	Standard	Warning Light: unit is in a safety condition prior to a safety shutdown
M10	Alarm	Standard	Alarm Light: unit is in a safety shutdown

1-1	Comp 1	Step w\ EXV	Compressor 1 Run Enable
1-2	SPARE1-2	Standard	Relay output not used
1-3	SPARE1-3	Standard	Relay output not used
1-4	SPARE1-4	Standard	Relay output not used
1-5	SPARE1-5	Standard	Relay output not used
1-6	SPARE1-6	Standard	Relay output not used
1-7	SPARE1-7	Standard	Relay output not used
1-8	SPARE1-8	Standard	Relay output not used
1-9	SPARE1-9	Standard	Relay output not used
1-10	SPARE1-10	Standard	Relay output not used

2-1	Comp 2	Step w\ EXV	Compressor 2 Run Enable
2-2	SPARE2-2	Standard	Relay output not used
2-3	SPARE2-3	Standard	Relay output not used
2-4	SPARE2-4	Standard	Relay output not used
2-5	SPARE2-5	Standard	Relay output not used
2-6	SPARE2-6	Standard	Relay output not used
2-7	SPARE2-7	Standard	Relay output not used
2-8	SPARE2-8	Standard	Relay output not used
2-9	SPARE2-9	Standard	Relay output not used
2-10	SPARE2-10	Standard	Relay output not used

3-1	Comp 3	Step w\ EXV	Compressor 3 Run Enable
3-2	SPARE2-2	Standard	Relay output not used

# Typical Points List

## Relay Outputs

#	Output Name	Type	Description
3-3	SPARE2-3	Standard	Relay output not used
3-4	SPARE2-4	Standard	Relay output not used
3-5	SPARE2-5	Standard	Relay output not used
3-6	SPARE2-6	Standard	Relay output not used
3-7	SPARE2-7	Standard	Relay output not used
3-8	SPARE2-8	Standard	Relay output not used
3-9	SPARE2-9	Standard	Relay output not used
3-10	SPARE2-10	Standard	Relay output not used

4-1	Cmp1Alarm	Standard	Comp 1 In Alarm Output
4-2	Cmp2Alarm	Standard	Comp 2 In Alarm Output
4-3	Cmp3Alarm	Standard	Comp 3 In Alarm Output

## Sensor Inputs

#	Output Name	Type	Description
M-1	ChilWtrIn	MCST100	Chilled Water In Temperature
M-2	ChilWtrOut	MCST100	Chilled Water Leaving Temperature
M-3	CndWtrIn	MCST100	Condenser water incoming temperature
M-4	CndWtrOut	MCST100	Condenser water leaving temperature
M-5	CndLevel	User Defined	Condenser Level Sensor
M-6	LoPsi SW 1	DIGITAL	Mechanical Low Psi Switch Comp 1
M-7	HiPsi SW 1	DIGITAL	Mechanical High Psi Switch Comp 1
M-8	LoPsi SW 2	DIGITAL	Mechanical Low Psi Switch Comp 2
M-9	HiPsi SW 2	DIGITAL	Mechanical High Psi Switch Comp 2
M10	LoPsi SW 3	DIGITAL	Mechanical Low Psi Switch Comp 3
M11	HiPsi SW 3	DIGITAL	Mechanical High Psi Switch Comp 3
M12	CndFlow	DIGITAL	Monitors the condenser flow
M13	ChwFlow	DIGITAL	Monitors the chilled water flow
M14	Phaseloss	DIGITAL	Phase loss: phase imbalance
M15	Run/Stop	DIGITAL	Run/Stop/Hand Switch
M16	Emg/Stop	DIGITAL	Emergency Stop Switch



# Typical Points List

## Sensor Inputs

#	Output Name	Type	Description
1-1	Cmp1 Fault	TurboCorFault	Compressor 1 Fault Message
1-2	Ctrl Mode1	ModbusHex	Compressor 1 Control Mode
1-3	IGV Open%	MODBUS	Inlet Guide Vane%-Compressor 1
1-4	SuctPsi 1	MODBUS	Suction Pressure - Compressor 1
1-5	DiscPsi 1	MODBUS	Discharge Pressure - Compressor 1
1-6	CavityTmp1	MODBUS	Cavity Temperature-Compressor 1
1-7	InvertTmp1	MODBUS	Inverter Temperature-Compressor 1
1-8	ChokSpeed1	MODBUS	Choke Speed-Compressor 1
1-9	SurgSpeed1	MODBUS	Surge Speed-Compressor 1
1-10	ActSpeed1	MODBUS	Actual Speed-Compressor 1
1-11	ComPSIRat1	MODBUS	Compressor 1 Pressure Ratio
1-12	Cmp1Amps	MODBUS	Compressor 1 Amperage
1-13	M IGV1STPS	MODBUS	Inlet Guide Vane Steps-Compressor 1
1-14	SPARE1-14	SPARE	Sensor input not used
1-15	SPARE1-15	SPARE	Sensor input not used
1-16	SPARE1-16	SPARE	Sensor input not used
2-1	Cmp2 Fault	TurboCorFault	Compressor 2 Fault Message
2-2	Ctrl Mode2	ModbusHex	Compressor 2 Control Mode
2-3	IGV Open%	MODBUS	Inlet Guide Vane%-Compressor 2
2-4	SuctPsi 2	MODBUS	Suction Pressure - Compressor 2
2-5	DiscPsi 2	MODBUS	Discharge Pressure - Compressor 2
2-6	CavityTmp2	MODBUS	Cavity Temperature-Compressor 2
2-7	InvertTmp2	MODBUS	Inverter Temperature-Compressor 2
2-8	ChokSpeed2	MODBUS	Choke Speed-Compressor 2
2-9	SurgSpeed2	MODBUS	Surge Speed-Compressor 2
2-10	ActSpeed2	MODBUS	Actual Speed-Compressor 2
2-11	ComPSIRat2	MODBUS	Compressor 2 Pressure Ratio
2-12	Cmp2Amps	MODBUS	Compressor 2 Amperage
2-13	M IGV2STPS	MODBUS	Inlet Guide Vane Steps-Compressor 2
2-14	SPARE2-14	SPARE	Sensor input not used
2-15	SPARE2-15	SPARE	Sensor input not used
2-16	SPARE2-16	SPARE	Sensor input not used

# Typical Points List

## Sensor Inputs

#	Output Name	Type	Description
3-1	Cmp3 Fault	TurboCorFault	Compressor 3 Fault Message
3-2	Ctrl Mode2	ModbusHex	Compressor 3 Control Mode
3-3	IGV Open%	MODBUS	Inlet Guide Vane%-Compressor 3
3-4	SuctPsi 2	MODBUS	Suction Pressure - Compressor 3
3-5	DiscPsi 2	MODBUS	Discharge Pressure - Compressor 3
3-6	CavityTmp2	MODBUS	Cavity Temperature-Compressor 3
3-7	InvertTmp2	MODBUS	Inverter Temperature-Compressor 3
3-8	ChokSpeed2	MODBUS	Choke Speed-Compressor 3
3-9	SurgSpeed2	MODBUS	Surge Speed-Compressor 3
3-10	ActSpeed2	MODBUS	Actual Speed-Compressor 3
3-11	ComPSIRat2	MODBUS	Compressor 3 Pressure Ratio
3-12	Cmp2Amps	MODBUS	Compressor 3 Amperage
3-13	M IGV2STPS	MODBUS	Inlet Guide Vane Steps-Compressor 3
3-14	SPARE2-14	SPARE	Sensor input not used
3-15	SPARE2-15	SPARE	Sensor input not used
3-16	SPARE2-16	SPARE	Sensor input not used

4-1	EvapPsi	MCS-200	Evaporator Pressure
4-2	DiscPsi 1	MCS-500	Discharge Pressure 1
4-3	DiscPsi 2	MCS-500	Discharge Pressure 2
4-4	DiscPsi 3	MCS-500	Discharge Pressure 3
4-5	LiqPsi	MCS-500	Liquid Pressure
4-6	SuctTmp 1	MCST100	Suction Temperature - Compressor 1
4-7	SuctTmp 2	MCST100	Suction Temperature - Compressor 2
4-8	SuctTmp 3	MCST100	Suction Temperature - Compressor 3
4-9	DiscTmp 1	MCST100	Discharge Temperature - Compressor 1
4-10	DiscTmp 2	MCST100	Discharge Temperature - Compressor 2
4-11	DiscTmp 3	MCST100	Discharge Temperature - Compressor 3
4-12	LiqTmp	MCST100	Liquid Temperature
4-13	Disable 1	DIGITAL	Turns Off Compressor 1
4-14	Disable 2	DIGITAL	Turns Off Compressor 2
4-15	Disable 3	DIGITAL	Turns Off Compressor 3
4-16	Ambient	MCST100	Outdoor Air Temperature



# Typical Points List

## Sensor Inputs

#	Output Name	Type	Description
5-1	Net R/S	BMS RUN	Building Management interface Run/Stop
5-2	NetReset	BMS CW RSET	Building Management interface target reset
5-3	NetDmdLmt	BMS Dmd FLA%	Building Management interface for Demand %

## Analog Outputs

#	Output Name	Description
M-1	Exv%	Electronic Expansion Valve Control Signal
M-2	StgValve1%	Compressor 1 Staging Valve
M-3	StgValve2%	Compressor 2 Staging Valve
M-4	StgValve3%	Compressor 3 Staging Valve
1-1	Demand 1%	Compressor 1 Speed Demand
1-2	SPARE1-2	Analog input not used
1-3	SPARE1-3	Analog input not used
1-4	SPARE1-4	Analog input not used
2-1	Demand 2%	Compressor 2 Speed Demand
2-2	SPARE2-2	Analog input not used
2-3	SPARE2-3	Analog input not used
2-4	SPARE2-4	Analog input not used
3-1	Demand 3%	Compressor 2 Speed Demand
3-2	SPARE2-2	Analog input not used
3-3	SPARE2-3	Analog input not used
3-4	SPARE2-4	Analog input not used

# Water Cooled Information

Please visit our website for a fillable form that you can email to: [sales@mcscontrols.com](mailto:sales@mcscontrols.com)

Company: \_\_\_\_\_ Phone: \_\_\_\_\_

Name: \_\_\_\_\_ Title: \_\_\_\_\_ Email: \_\_\_\_\_

Mobile: \_\_\_\_\_ Jobsite: \_\_\_\_\_

Chiller Manufacturer	Chiller Model Number	Chiller Serial Number	Refrigerant Type

How are the new controls from MCS provided:      In MCS Control Enclosure      Field mount new boards in existing cabinet

How many Circuits? \_\_\_\_\_ How many compressors per circuit? \_\_\_\_\_

1. Compressor Model(s):    Comp #1: \_\_\_\_\_    Comp #2: \_\_\_\_\_    Comp #3: \_\_\_\_\_    Comp #4: \_\_\_\_\_

2. What is the compressor's Full Load Amps (FLA)?    Comp #1: \_\_\_\_\_    Comp #2: \_\_\_\_\_    Comp #3: \_\_\_\_\_    Comp #4: \_\_\_\_\_

3. Does / Will unit have a refrigerant Level Sensor      Yes      No    If no, MCS will control on Suction Superheat.

If yes, is the Level Sensor located on:      Evaporator      Condenser

Level Sensor Model: \_\_\_\_\_      Signal Output? \_\_\_\_\_

4. What model EXVS will you be using for: refrigerant level/superheat control? \_\_\_\_\_    How many EXVS? \_\_\_\_\_

5. Does / Will you be using a staging valve for each compressor?      Yes      No  
(comes off the discharge of compressor BEFORE the check valve and goes back to suction side of compressor. Each compressor will have its own valve)

If yes, what model valves?    Comp #1: \_\_\_\_\_    Comp #2: \_\_\_\_\_    Comp #3: \_\_\_\_\_    Comp #4: \_\_\_\_\_

6. Does / Will you be using a (LBV) load balancing valve (aka hot gas valve) on the unit?      Yes      No  
(comes off the discharge of compressor AFTER the check valve)    If yes, what model valve? \_\_\_\_\_

7. Will MCS control the Condenser?      Yes      No    Condenser type? \_\_\_\_\_

Will the Condenser Water Pump be wired or will a Condenser Isolation Valve be used? \_\_\_\_\_

If Air Cooled, Common Condenser?      Yes      No

If yes, how many fans? \_\_\_\_\_    If no, how many fans per circuit? \_\_\_\_\_    VFD on first fan, per circuit?      Yes      No

8. Will MCS control the Evaporator?      Yes      No    If yes, 1 or 2 pumps? \_\_\_\_\_    VFD's?      Yes      No

9. Is there an Economizer on this chiller?      Yes      No    Type of Economizer? \_\_\_\_\_

If 'None', what type of econo control used to the compressor? \_\_\_\_\_  
(EXV modulated based on econo superheat(requires econo suct psi & Temp)

10. Will the unit be communicating to BMS?      Yes      No    What Protocol will be used to BMS? \_\_\_\_\_

COMMENTS (is there any other information we should know?):





5580 Enterprise Pkwy., Fort Myers, FL 33905

Office: 239-694-0089 • Fax: 239-694-0031

[www.mcscontrols.com](http://www.mcscontrols.com)