


MCS-MODBUS-IO #1
(RO Address #0)
(SI Address #3)

Program Select
5 = Danfoss CDS
Note: Program will be loaded on reset or power-up.

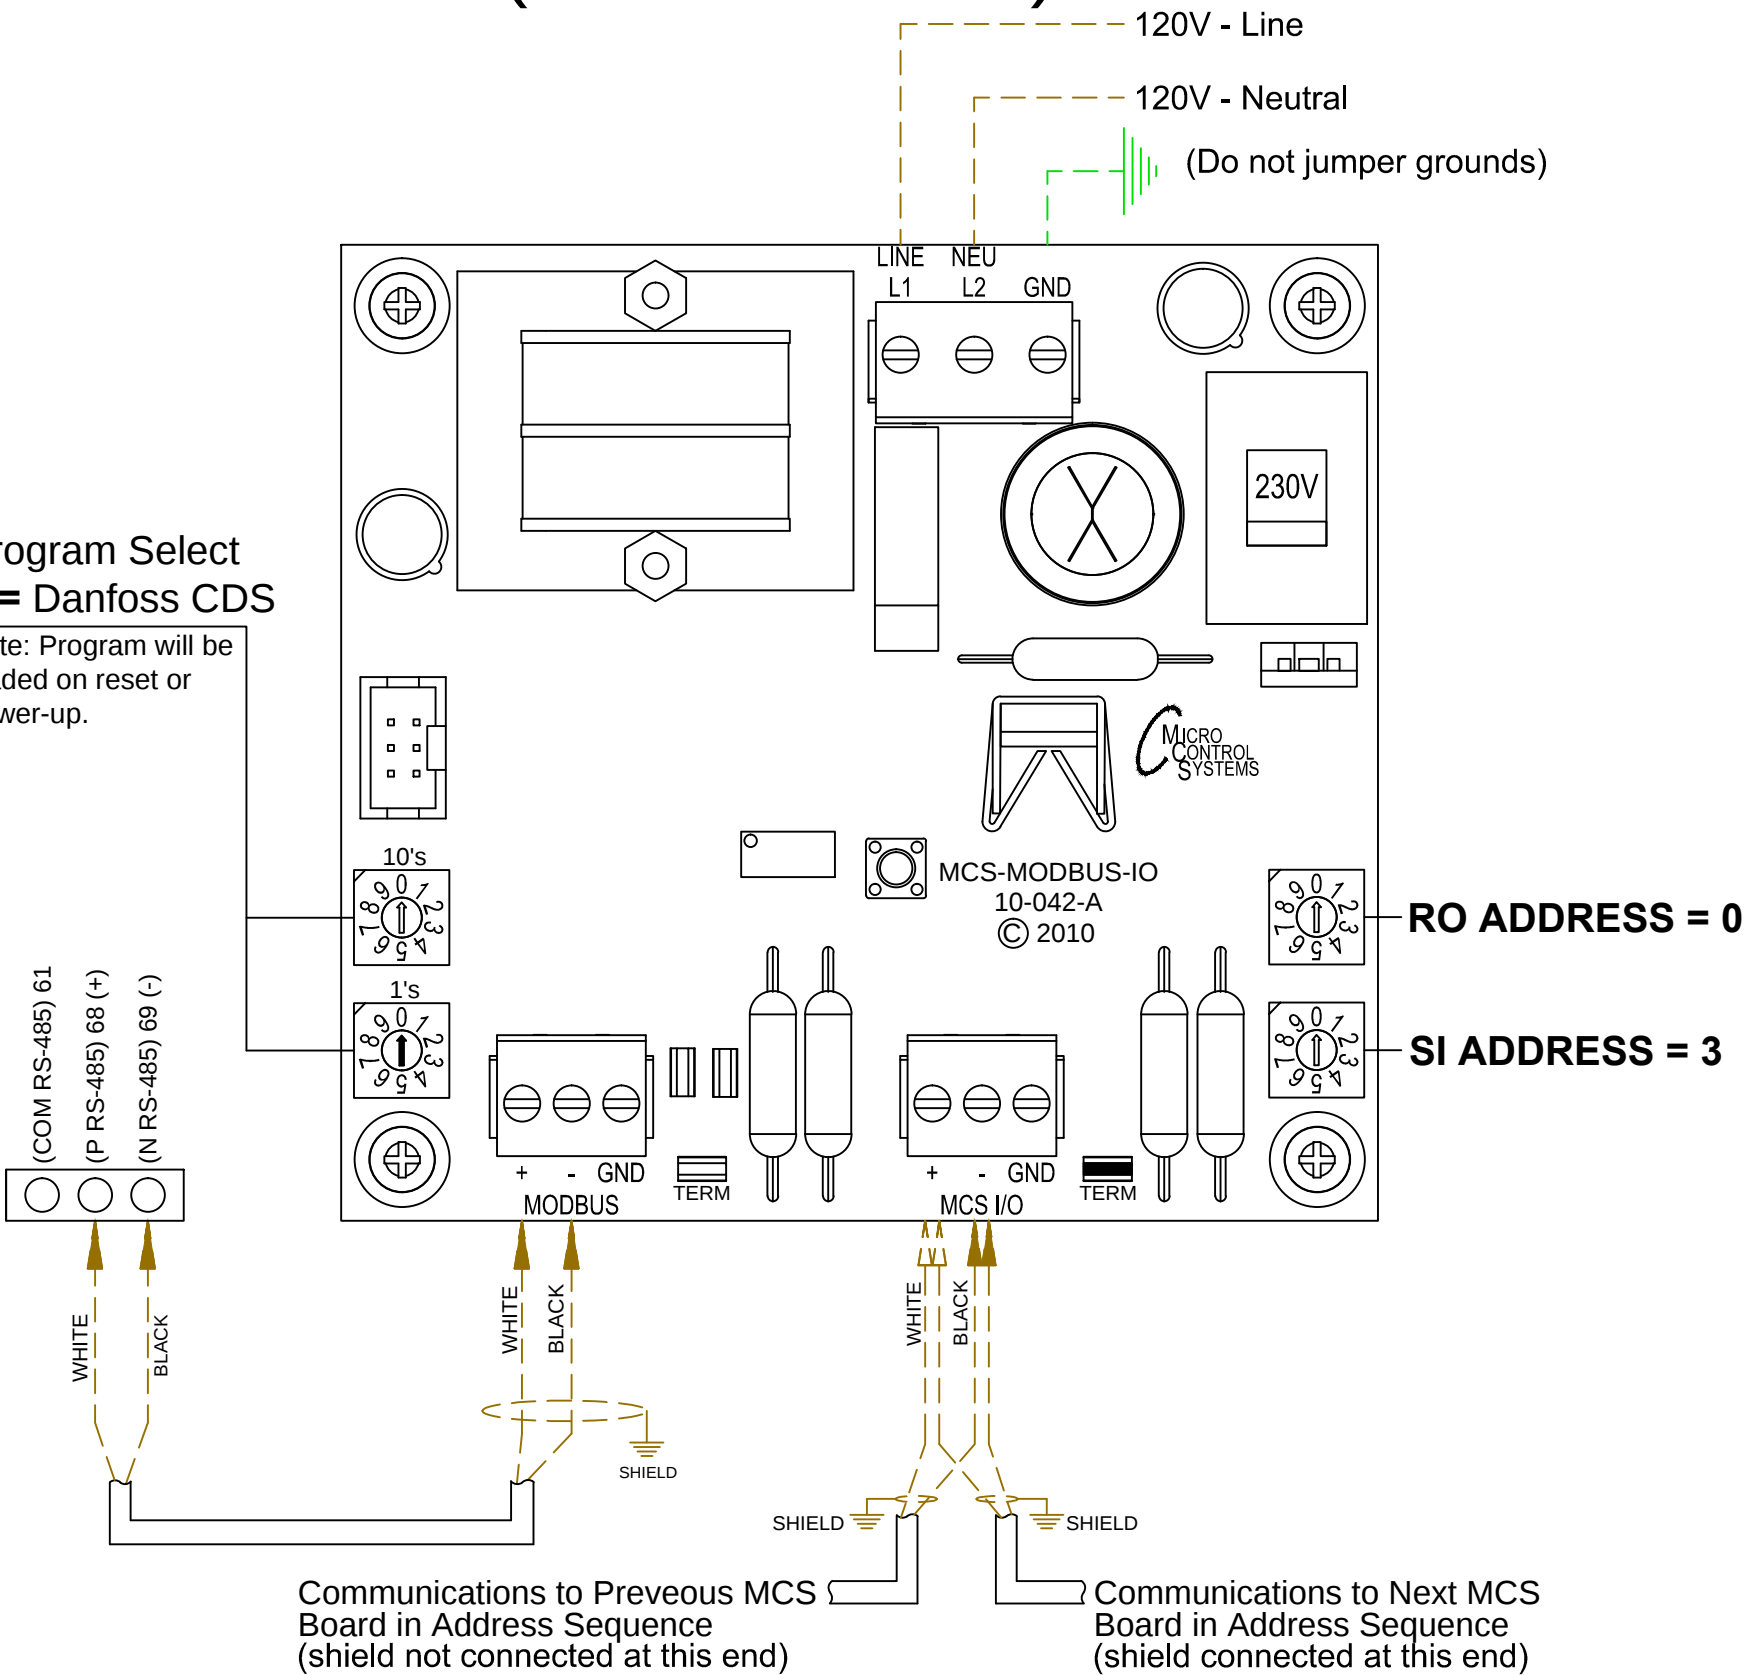

Danfoss CDS Modbus Points					
	RO		SI		AO
3-1	Spare	3-1	VFDStatus	3-1	COMP CMD1
3-2	Spare	3-2	VFD KW	3-2	COMP 1%
3-3	Spare	3-3	VFD Volt	3-3	Spare
3-4	Spare	3-4	VFD Amps	3-4	Spare
3-5	Spare	3-5	VFD RPM		
3-6	Spare	3-6	VFDDCVolt		
3-7	Spare	3-7	VFDTemp		
3-8	Spare	3-8	VFD1Alm1Hi		
3-9	Spare	3-9	VFD1Alm1Lo		
3-10	Spare	3-10	VFD1Alm2Hi		
		3-11	VFD1Alm2Lo		
		3-12	Spare		
		3-13	Spare		
		3-14	Spare		
		3-15	Spare		
		3-16	Spare		

Factory wired: _____
Field wired: - - - - -
Analog Sensor Jumper : ☐
Digital Sensor Jumper : ☐

	Job Site Name	
	Customer Name	
	Unit Type	
	SO# - Drawing #	
	Revision	Date
	CAD Tech	Page #